


NOTE.

CONTACTS & TERMINALS INSIDE DOTTED LINE ARE ON EXISTING A.C. CONTROLLER. AT LEAST TWO SUPPLY LINES MUST BE OPENED AS INDICATED.

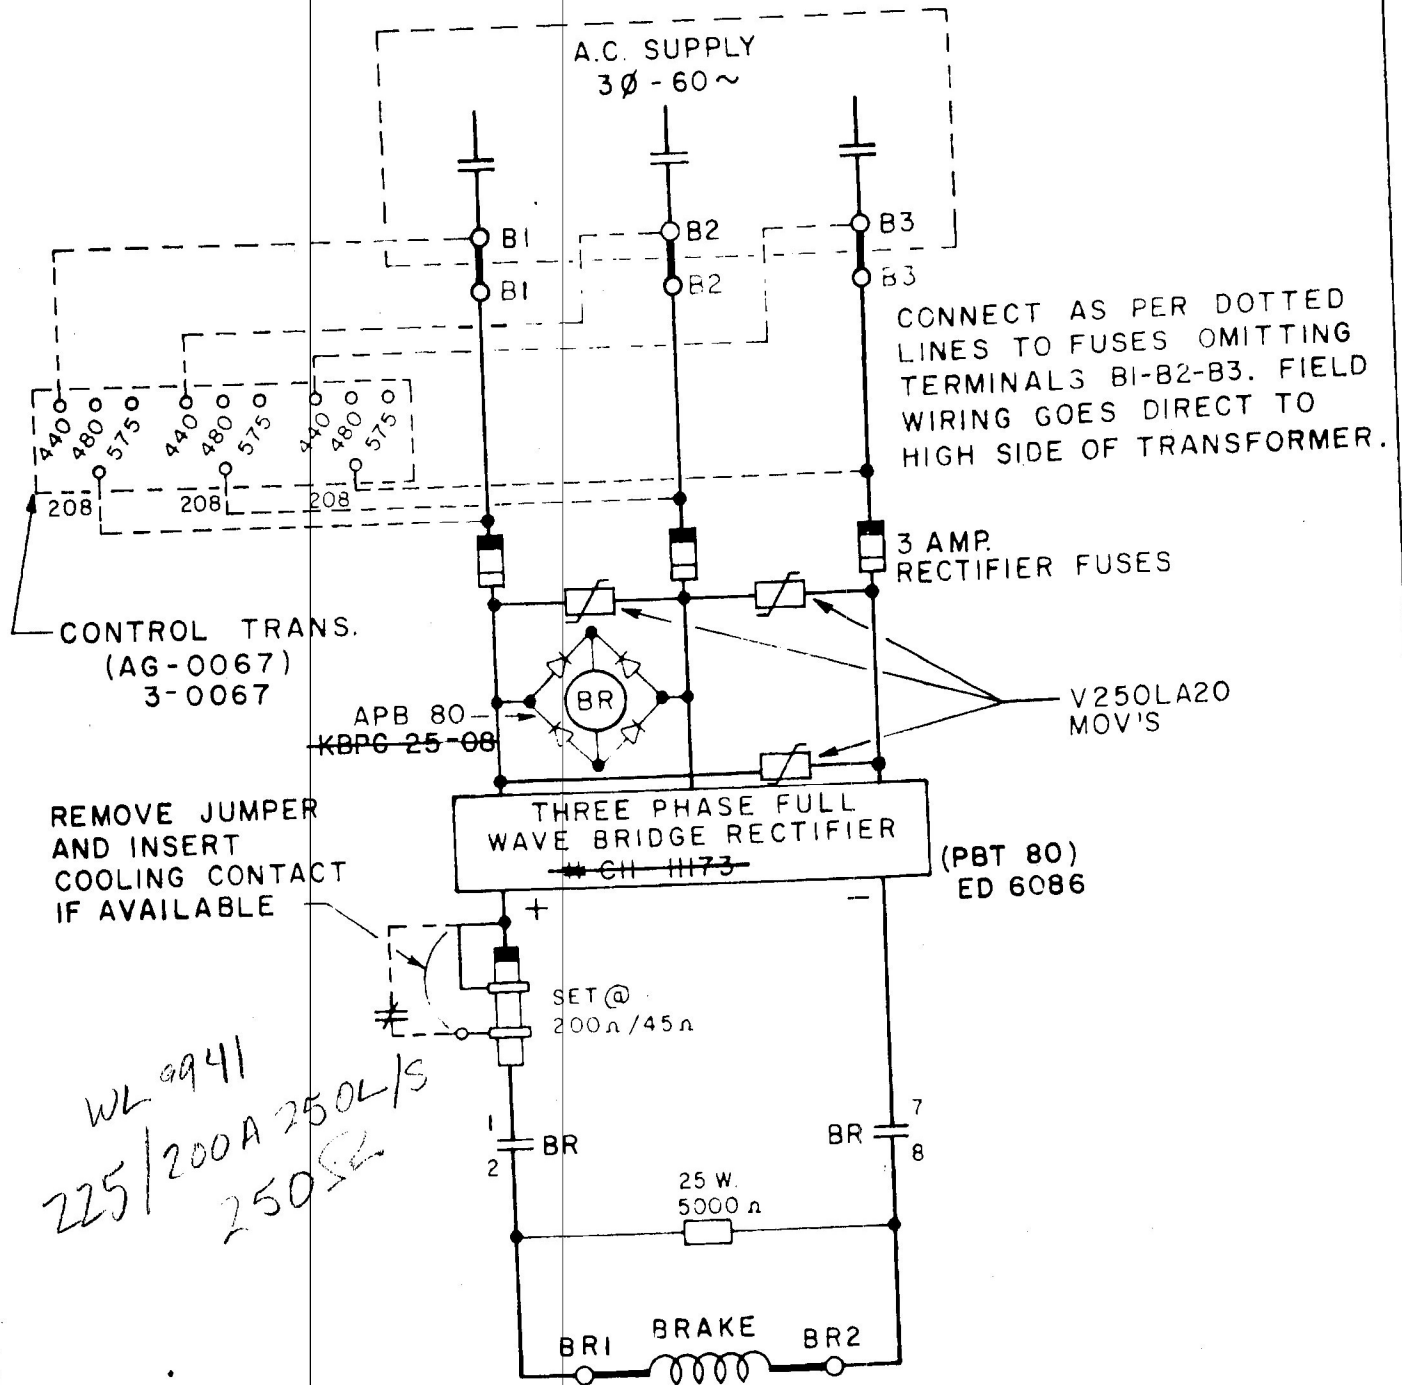

REMOVE JUMPER AND INSERT COOLING CONTACT IF AVAILABLE

*WL 9941*  
*225/200A 250L/S*  
*250SE*

REVISED 5/21/75  
"BR" RELAY WITH COIL 5693 REPLACED WITH FABRICATED RELAY USING COIL S6438 23000T 39 W AND RELAY RECTIFIER K9H 2506

WIRING DIAGRAM FOR REPLACING A.C. BRAKE WITH 16"-18" OR 20" H.W. D.C. BRAKE

DATE 2-24-70

S-10,019-1