

G.A.L. JET PLUS ORDER FORM


1046-TE CAR STATION

UP TO 10 LANDINGS

Single column of floor buttons up to 5 landings. Double 6 to 10 landings



GAL No. _____

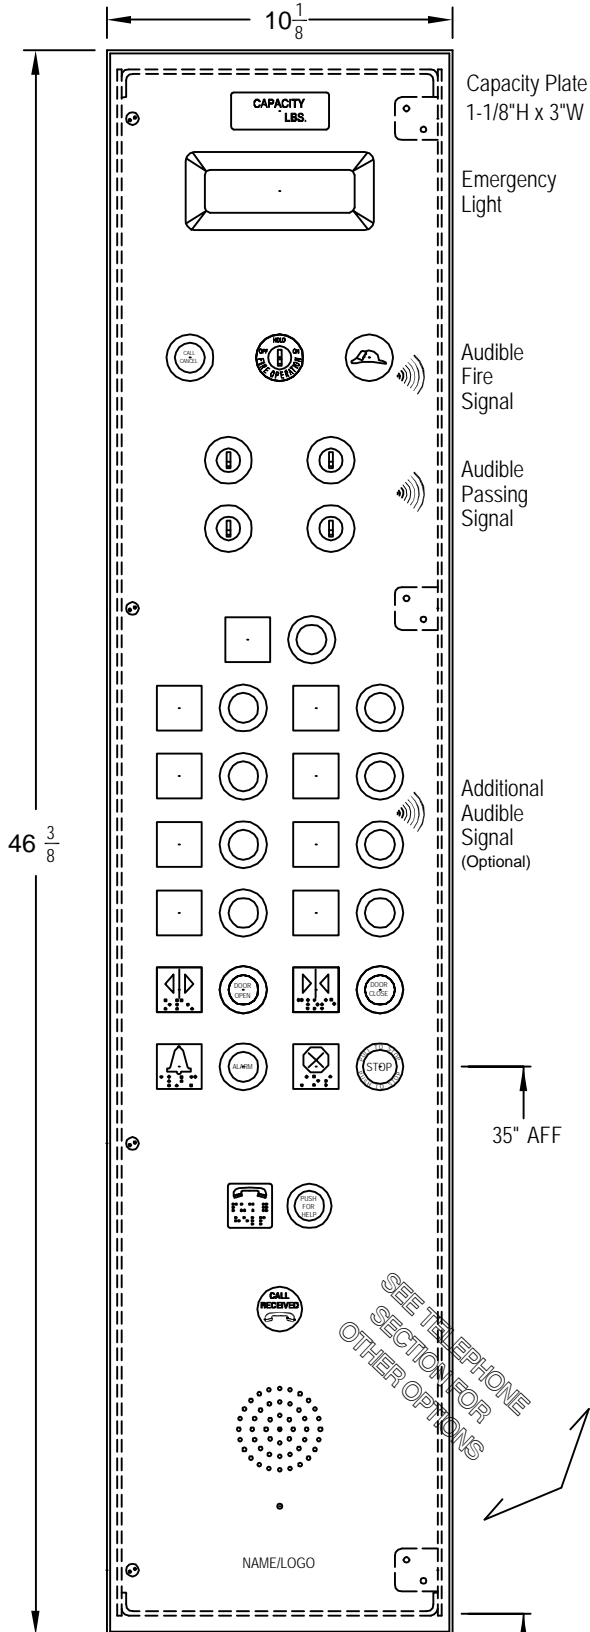

Box Cutout $9 \frac{5}{8} \times 45 \frac{3}{8}$
 Box Depth $3 \frac{1}{2}$

$18 \frac{7}{8}$ AFF
 Box Cutout

PLEASE COMPLETE THE FOLLOWING

Company Name _____	Job Name/Number _____
Cover Material	
<input type="checkbox"/> 1/8" #4 Satin Finish	<input type="checkbox"/> Stainless Steel <input type="checkbox"/> Muntz
Voltage	
<input type="checkbox"/> AC <input type="checkbox"/> DC	<input type="checkbox"/> 6 <input type="checkbox"/> 12 <input type="checkbox"/> 24 <input type="checkbox"/> 28 <input type="checkbox"/> 35 <input type="checkbox"/> 48 <input type="checkbox"/> 60 <input type="checkbox"/> 120 <input type="checkbox"/> 120 Neon
Fire Operation <input type="checkbox"/> None NOTE: SPECIFY WHICH CODE APPLIES	
<input type="checkbox"/> ASME - 2000 <input type="checkbox"/> Mass./ Maine/ New Hampshire <input type="checkbox"/> S. Carolina	<input type="checkbox"/> ASME - 1996 <input type="checkbox"/> N. Rochelle/Yonkers,NY <input type="checkbox"/> Mt. Vernon,NY
<input type="checkbox"/> Penn. (Old) <input type="checkbox"/> New York City <input type="checkbox"/> White Plains,NY	<input type="checkbox"/> Connecticut <input type="checkbox"/> Other Code _____
Key Switches <input type="checkbox"/> None <small>Cylinder choice also applies to Fire Operation for ASME and PA.</small>	
<input type="checkbox"/> GAL Std. Chicago Cylinder	<input type="checkbox"/> Medeco Security Cylinder
Choose up to 5 key switches. A light up indicator may be substituted. Please advise.	
<input type="checkbox"/> Light <input type="checkbox"/> Fan (1sp) <input type="checkbox"/> Fan (2sp) <input type="checkbox"/> Light/Fan (1sp) <input type="checkbox"/> Ind. Service	<input type="checkbox"/> Inspection (for in car inspection) <input type="checkbox"/> Electric Eye <input type="checkbox"/> Door Hold
<input type="checkbox"/> Access, off / on <input type="checkbox"/> Combination Access / Inspection switch.	Enables hoistway access sw's. per ASME-2000 code.
<input type="checkbox"/> Mass. EMT Key Switch, Light & Audible Signal	<input type="checkbox"/> Other _____
Additional Audible Signal	
<input type="checkbox"/> Yes <input type="checkbox"/> No	(Used for Reduced Speed Door Close, etc.)
Push Button Style	
<input type="checkbox"/> California 1/8" Protruding Buttons Used By Passengers (Not available with SH). Includes Engraving For Alarm Button.	
<input type="checkbox"/> RWB	<input type="checkbox"/> SWB
<input type="checkbox"/> VPB	<input type="checkbox"/> SH
<input type="checkbox"/> RBW	<input type="checkbox"/> SBW
<input type="checkbox"/> VPV	<input type="checkbox"/> VPW
<input type="checkbox"/> RWW	<input type="checkbox"/> SWW
<input type="checkbox"/> VP	
Number of Floors _____	
Floor Markings _____	
Circle egress (★) floor	
Stop Switch	
<input type="checkbox"/> Toggle	<input type="checkbox"/> Key Operated <input type="checkbox"/> Pull to Stop
Engraving <input type="checkbox"/> Plate <input type="checkbox"/> Logo	
Capacity _____	<input type="checkbox"/> Name _____
Telephone	
<input type="checkbox"/> G.A.L. Hands Free Phone, Cover Mounted (Shown)	
<input type="checkbox"/> G.A.L. Hands Free Phone, Inside Compartment	
<input type="checkbox"/> Phone Compartment (Without phone unit)	
Hinge	Quantity
<input type="checkbox"/> As shown <input type="checkbox"/> Opposite	_____

SEE TELEPHONE SECTION FOR OTHER OPTIONS